


SCIOTO VALLEY PRECAST COMPANY

3218 S. BRIDGE STREET

CHILLICOTHE, OHIO 45601

PHONE (740) 663-2659

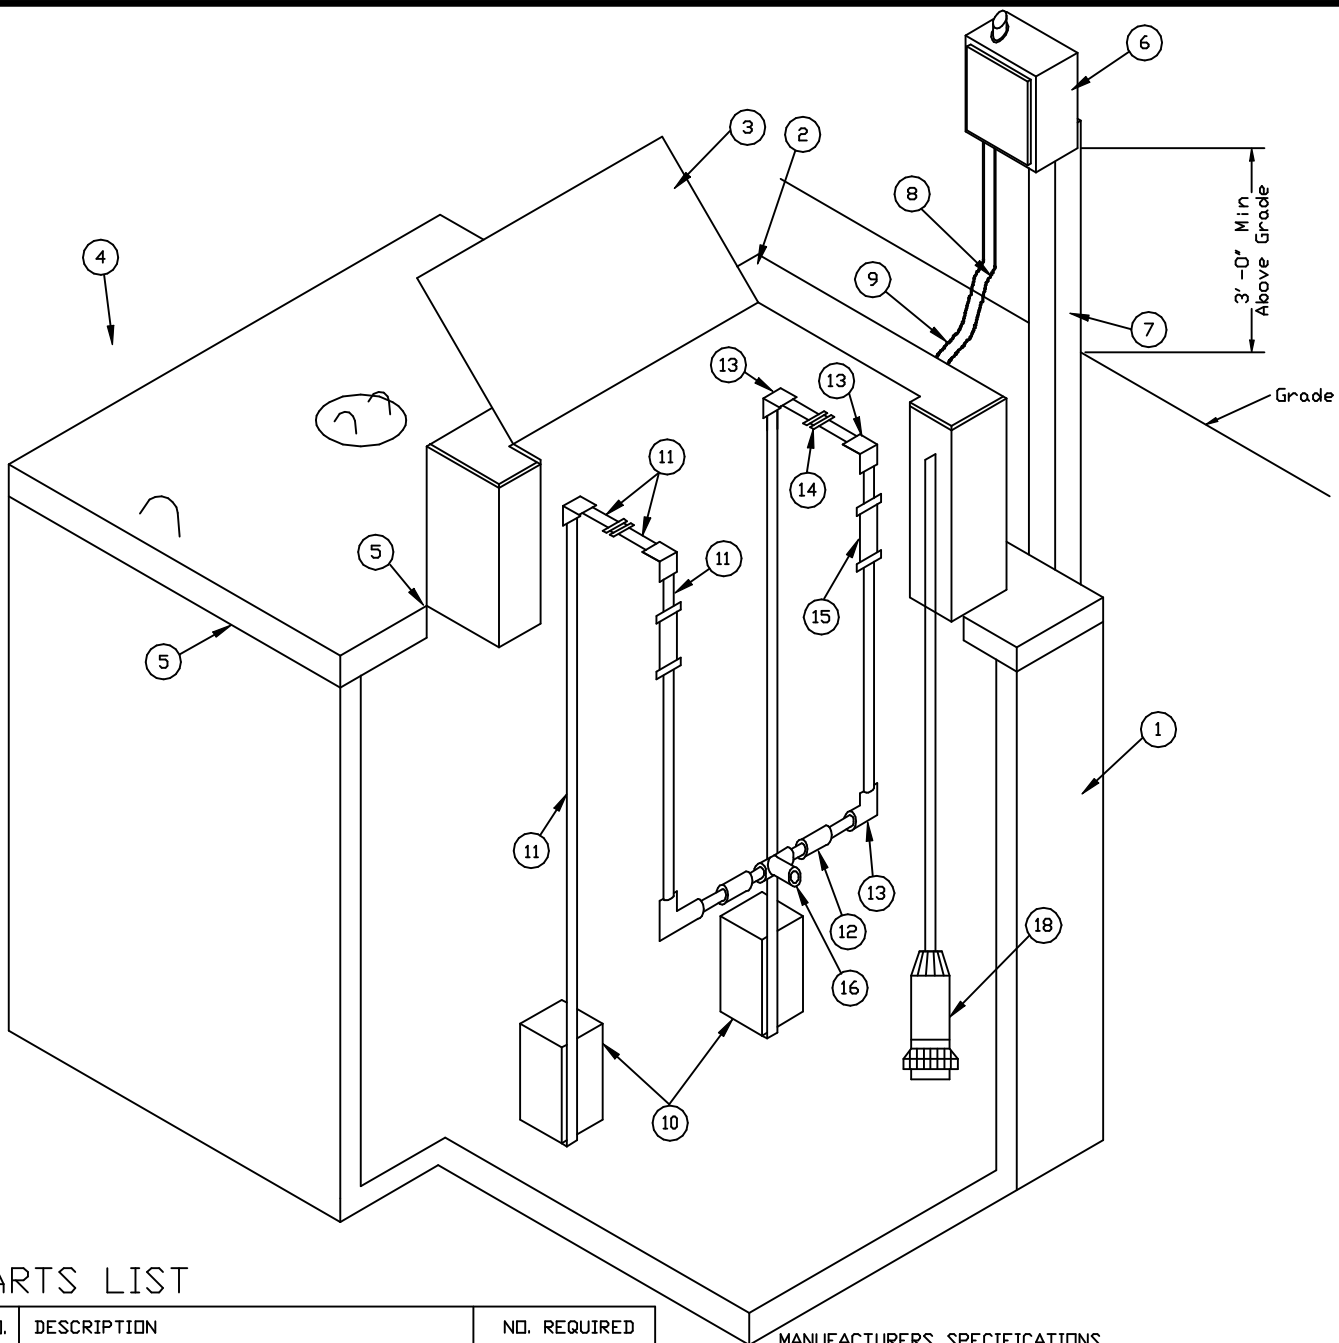

PARTS LIST

| NO. | DESCRIPTION | NO. REQUIRED |
|-----|---------------------------------------|--------------|
| 1 | 1000 GAL. TANK | 1 EA. |
| 2 | 3' X 4' RECT. CONC. MANHOLE | 1 EA. |
| 3 | MANHOLE COVER | 1 EA. |
| 4 | 4" DIA. PIPE SEAL (INLET) | 1 EA. |
| 5 | SEALANT 1/2" X 3/4" | 2 EA. |
| 6 | AMERICAN MFG. CONTROL PANEL | 1 EA. |
| 7 | 4" X 4" TREATED POST | 1 EA. |
| 8 | 3/4" FLEX CONDUIT TO FLOATS | 1 EA. |
| 9 | 1/2" FLEX CONDUIT TO SUBMERSIBLE PUMP | 1 EA. |
| 10 | SUBMERSIBLE PUMP | 2 EA. |
| 11 | 1 1/2" PVC PIPING SYSTEM | |
| 12 | 1 1/2" PVC CHECK VALVE | 2 EA. |
| 13 | 1 1/2" 90° SCH 80 PVC ELBOW | |
| 14 | 1 1/2" PVC COUPLING | |
| 15 | 1 1/2" PVC EXPANSION COUPLING | 2 EA. |
| 16 | 1 1/2" SCH 80 PVC TEE | 1 EA. |
| 17 | 1 1/2" RUBBER PIPE SEAL (OUTLET) | 1 EA. |
| 18 | PRESSURE BELL | 1 EA. |

MANUFACTURERS SPECIFICATIONS

CONTROL PANEL

TYPE: _____

MODEL NO. _____

S/N _____

MANHOLE COVER

TYPE: _____

MODEL NO. _____

S/N _____

PRESSURE BELL

TYPE: _____

MODEL NO. _____

S/N _____

PUMPS

TYPE: _____

MODEL NO. _____

S/N _____

NOTE: 2" PVC PIPING SYSTEM MAY BE SUBSTITUTED FOR THE 1 1/2" PIPING SYSTEM.

TWIN PUMP LIFT STATION